


METRIC STANDARD DRAWING FOR
ELECTRIC SERVICE POLE AND LATERAL

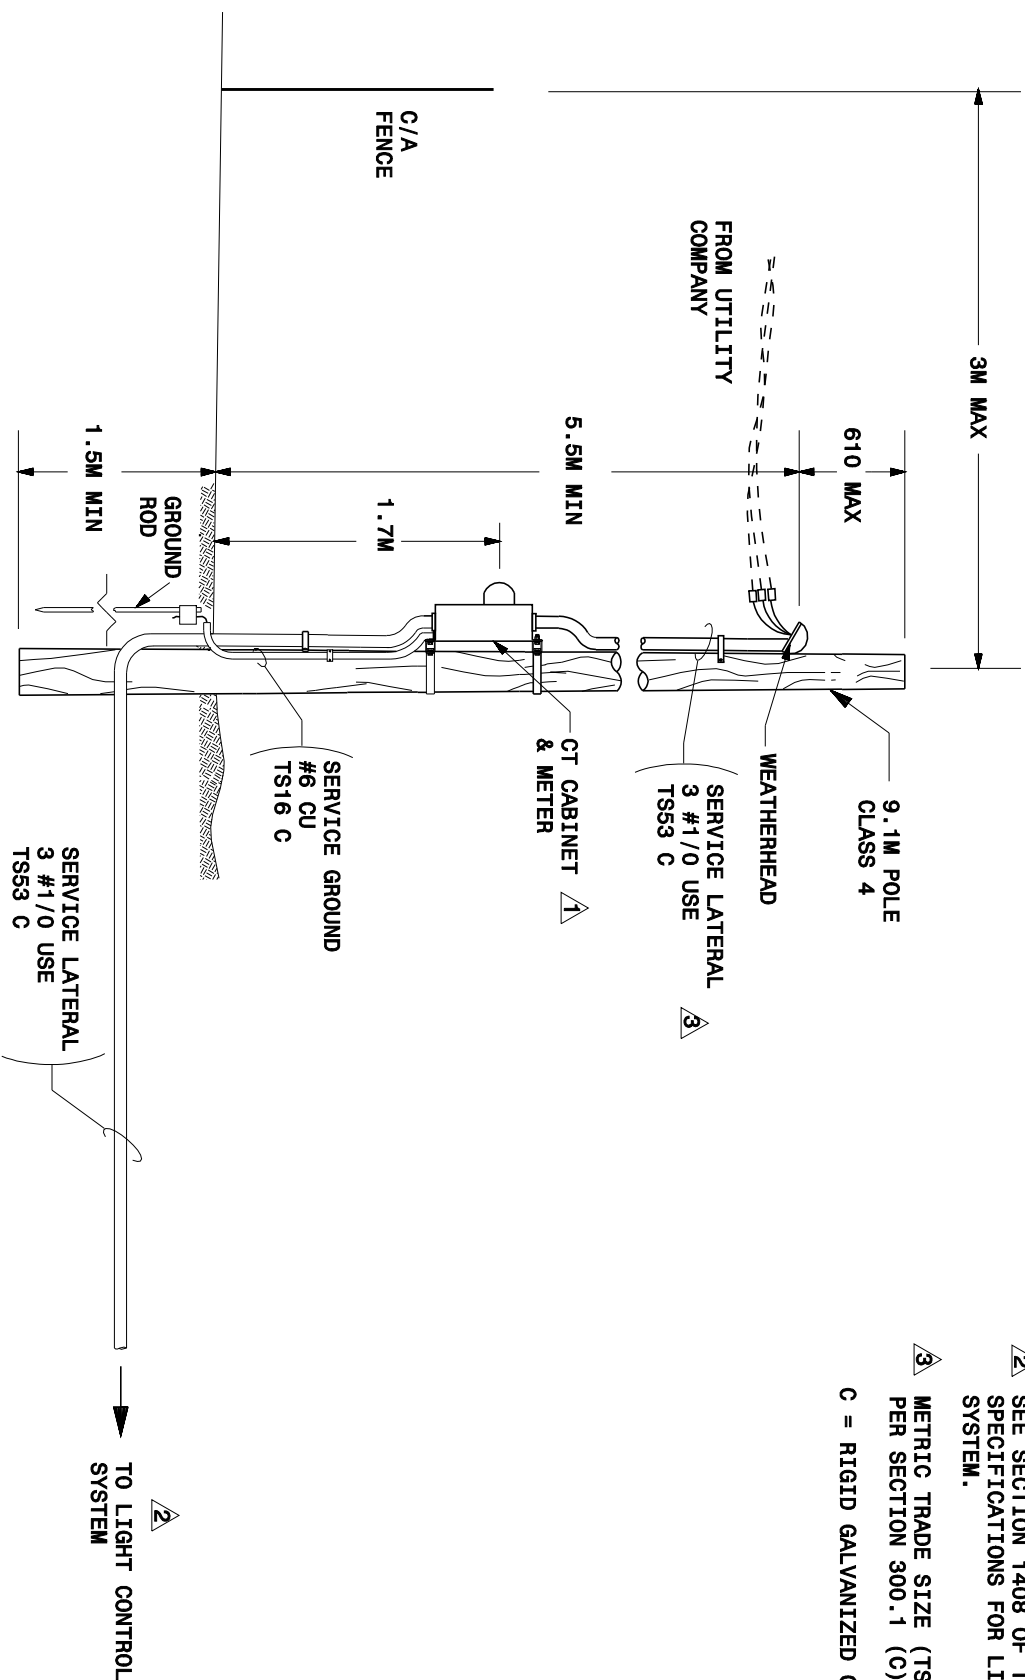

NOTES

- 1 CURRENT TRANSFORMER (CT) CABINET AND METER MAY BE MOUNTED ON BACK OF LIGHT CONTROL SYSTEM ENCLOSURE.
- 2 SEE SECTION 1408 OF THE STANDARD SPECIFICATIONS FOR LIGHT CONTROL SYSTEM.
- 3 METRIC TRADE SIZE (TS) FOR CONDUIT PER SECTION 300.1 (C) OF THE NEC.
C = RIGID GALVANIZED CONDUIT

SERVICE POLE

Note:
This drawing is dimensioned in millimeters unless otherwise depicted within the drawing.

METRIC STANDARD DRAWING FOR
ELECTRIC SERVICE POLE AND LATERAL